

# **Certificate of Compliance**

Certificate: 70126847 Master Contract: 263009

**Project:** 80201322 **Date Issued:** 2024-03-18

**Issued To: GIZMO Products Inc.** 

3 North Newark St.

Phelps, New York, 14532

**United States** 

**Attention:** Peter Blokhuis

The products listed below are eligible to bear the CSA Mark shown with adjacent indicators 'C' and 'US' for Canada and US or with adjacent indicator 'US' for US only or without either indicator for Canada only.

Issued by: Alison Cheng Alison Cheng



### **PRODUCTS**

 $\pmb{CLASS~2258~04}~- \ PROCESS~CONTROL~EQUIPMENT~- Intrinsically~Safe~Entity~- For~Hazardous~Locations$ 

CLASS 2258 84 - PROCESS CONTROL EQUIPMENT - Intrinsically Safe Entity - For Hazardous Locations - Certified to US Standards


Ex ia IIB T4 Ga Class I, Zone 0, AEx ia IIB T4 Ga Class I, Div. 1 Groups C and D T4, IP65

Alarm Box IS-AB, Tank Alarm IS-T, and Drum Alarm IS-D are battery operated devices with maximum input voltage of 7.2Vdc derived from battery pack model BT-IS. The operating temperature range is  $-40^{\circ}$ C  $\leq$  Tamb  $\leq$   $+60^{\circ}$ C. The device is for use in hazardous location and provides intrinsically safe connections to relay contacts and to the simple apparatus (passive component) contacts, which are illustrated as level switches in the control drawing IS-001. The Alarm device Input Entity Parameters are: Vmax = 28Vdc, Imax = 100mA, Pmax = 700mW, Ci = 0 and Li = 0.



 Certificate: 70126847
 Master Contract: 263009

 Project: 80201322
 Date Issued: 2024-03-18

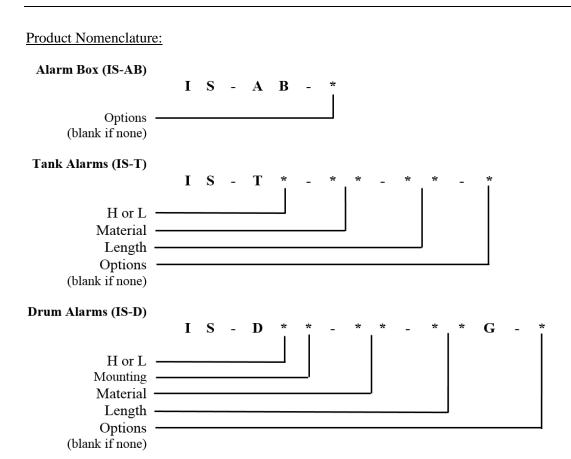

#### Note:

1. Environmental Conditions: Outdoor, -40°C to +60°C, 2000m max.

### **Conditions of Acceptability:**

- 1. For safe installation of the device, refer to the Alarm Instruction document; Instructions IS-AB, IS-T, and IS-D.
- 2. Only Intrinsically Safe battery package BT-IS must be used with Drum Alarm models IS-AB, IS-T and IS-D.
- 3. The Relay output contact terminals shall connect to a certified I.S. Barrier only.
- 4. The enclosure of Alarm models IS-T and IS-D are made from Aluminum. In rare cases, ignition sources due to impact and friction sparks could occur. This shall be considered during installation and use. Use care not to cause impacts or scrapes with other metal objects during installation.
- 5. Under certain extreme circumstances, exposed plastic and unearthed metal parts of the enclosure of models IS-T, IS-D may store an ignition capable of an electrostatic charge. Therefore, the user/installer shall implement provisions to prevent the buildup of electrostatic charge, i.e. locate the equipment where a charge-generating mechanism is unlikely to be present, and clean with a water-moistened cloth.
- 6. Simple Apparatus (passive component) is permitted for connection with models IS-AB, IS-T or IS-D, provided that the end user must comply with the following conditions:



 Certificate: 70126847
 Master Contract: 263009

 Project: 80201322
 Date Issued: 2024-03-18

- the Simple Apparatus switches are used within their ratings
- the Entity parameters of Drum Alarm device are regarded and correctly applied when connecting the Simple Apparatus switch.
- the Simple Apparatus switch used with any Drum Alarm models IS-AB, IS-T or IS-D shall not form or considered part of the Drum Alarm device.

## **APPLICABLE REQUIREMENTS**

CAN/CSA-C22.2 No. 60079-0:15	Explosive atmospheres - Part 0: Equipment - General requirements
CAN/CSA-C22.2 No. 60079-11:14	Explosive atmospheres - Part 11: Equipment protection by intrinsic safety "i"
ANSI/ISA-60079-0 (12.00.01)-2013	Explosive atmospheres - Part 0: Equipment - General requirements
ANSI/ISA 60079-11 (12.02.01)-2014	Explosive atmospheres - Part 11: Equipment protection by intrinsic safety "i"
CAN/CSA C22.2 No. 61010-1-12	Safety Requirements for Electrical Equipment for Measurement, Control, and Laboratory Use, Part 1: General Requirements
ANSI/UL 61010-1, 3 <sup>rd</sup> Edition	Safety Requirements for Electrical Equipment for Measurement, Control, and Laboratory Use, Part 1: General Requirements
UL913 Ed 8.0	Intrinsically Safe Apparatus and Associated Apparatus for Use in Class I, II, and III, Division 1, Hazardous (Classified) Locations

#### Notes:

Products certified under Class C225804, C225884 have been certified under CSA's ISO/IEC 17065 accreditation with the Standards Council of Canada (SCC). www.scc.ca





# Supplement to Certificate of Compliance

Certificate: 70126847 Master Contract: 263009

The products listed, including the latest revision described below, are eligible to be marked in accordance with the referenced Certificate.

# **Product Certification History**

Project	Date	Description
80201322	2024-03-18	Update to Report 70126847 for Alarm Box IS-AB, Tank Alarm IS-T, and Drum Alarm IS-D to improve the sound volume from piezoelectric buzzer by revising components on the main board.
80103514	2022-01-10	Update of cCSAus report # 70126847 for Alarm Box IS-AB, Tank Alarm IS-T, and Drum Alarm IS-D to correct few typographic errors for conduit body model designation, main enclosure manufacturer, marking and labelling system part number, and warble tone circuit model number.
70210677	2019-01-28	Update CSA report 70126847 to allow the use of simple apparatus switches for providing signal to the Alarm system when used within the entity parameter specifications.
70181458	2018-04-26	Update CSA report 70126847 to include an additional standard UL-913 Ed.8.
70161199	2018-01-17	Update to CSA Report 70126847 to make the previously certified model names changed to IS-AB and IS-T, to include a variation model IS-D, to make minor changes to the buzzer circuit to improve performance, to give IP65 rating to models IS-T and IS-D, and to update descriptive documents.
70126847	2017-09-12	Original cCSAus certification for Drum Alarm Models AB-IS and T-IS as Intrinsically Safe for Ex ia IIB T4 Ga and Class I Div.1 with Ta max = $60^{\circ}$ C with battery model BT-IS.